




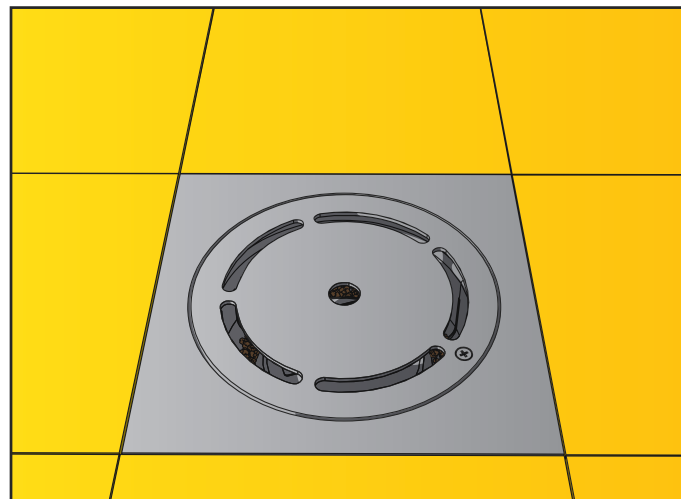


Follow this easy step-by-step maintenance guide for your HB125, HB200, HB250 and HB280 floor drains, to ensure that your drains are working optimally.

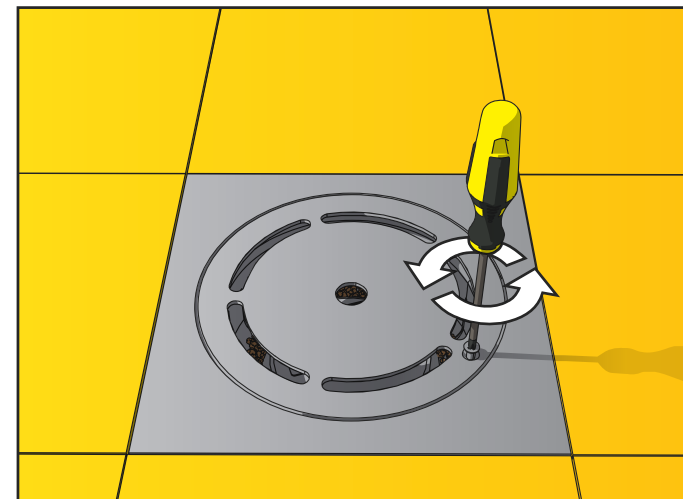


1 Remove the tamper proof screw from the lid and lift the lid off the floor drain. Store in a safe place.

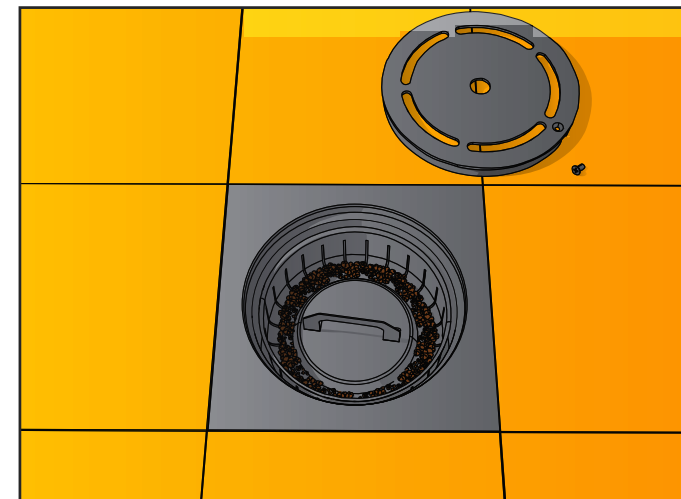


2 The solids basket is now visible. Check to see if the basket has solids trapped in it

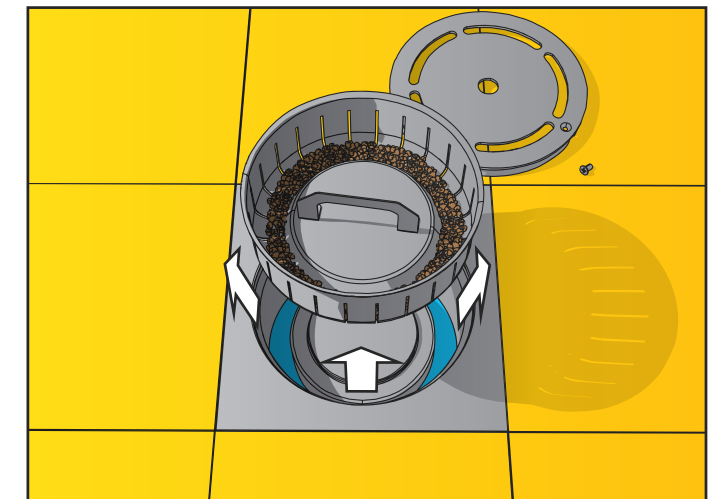


3 lift the basket out of the floor drain. If there are solids dump the contents in a suitable waste bin.

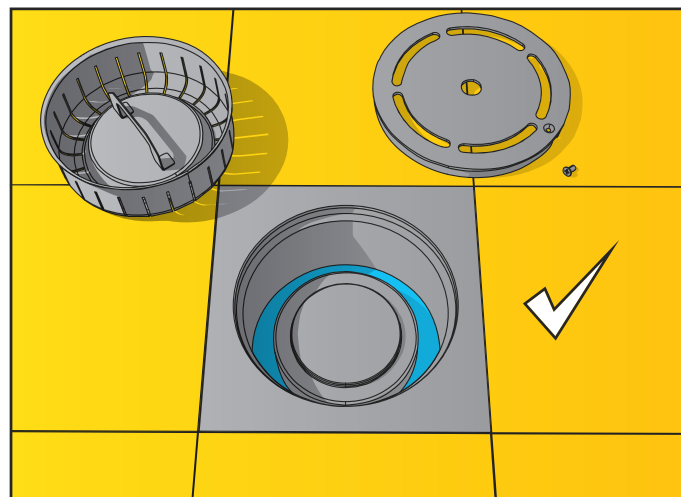


4 While the basket is out of the floor drain, the top of the water seal assembly is visible. Make sure that there is water in the bottom of the floor drain. This water must be in the floor drain as it forms part of the odour seal. If the water is not there... Go to step 5. If there is water clean the inside of the floor drain with a mild dishwashing soap solution. Rinse out then... Go to step 8

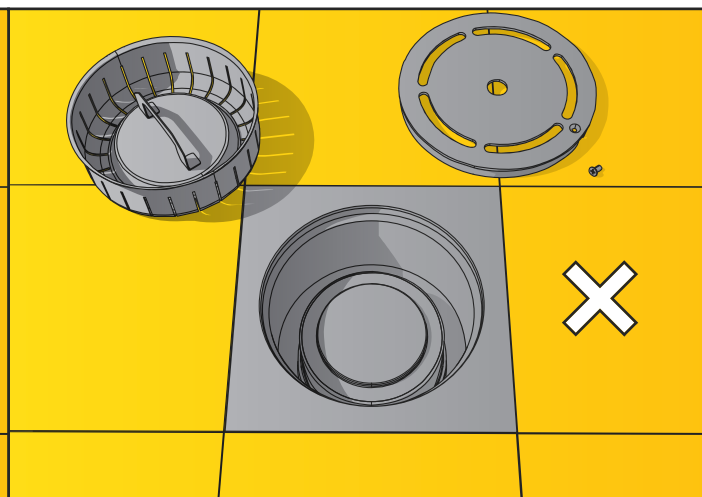


5 Remove the water seal assembly and inspect the rubber seal. If the rubber seal is damaged, replace the rubber seal.

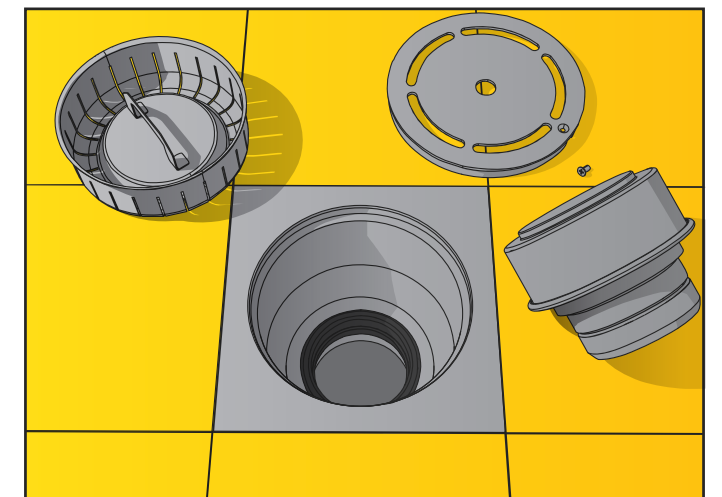


6 While the water seal assembly is removed, clean the inside of the floor drain with a mild dishwashing soap solution. Rinse out.

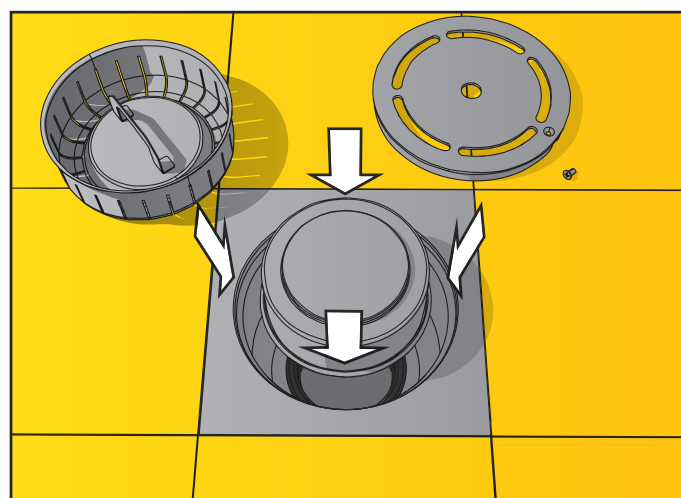


7 If the rubber seal is not damaged, carefully replace the water seal assembly back into the floor drain and add water to form the odour seal again.

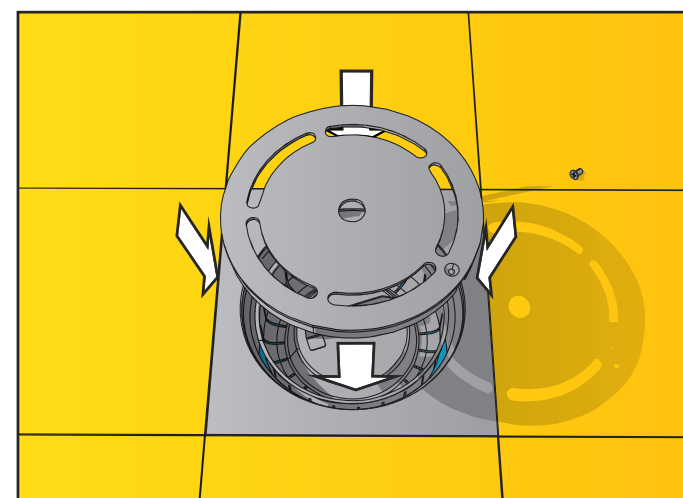

8 Clean the solids basket and lid with a mild dishwashing soap solution. Rinse out. Place the basket and lid back in to the drain.

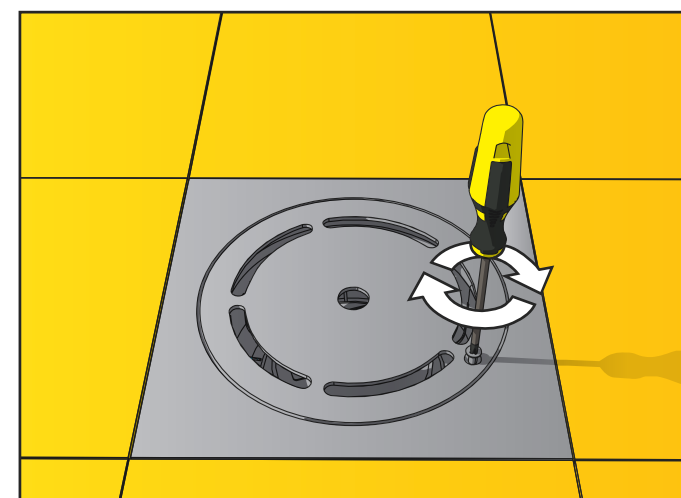

9 Screw down the lid using the tamper proof screw you removed earlier.

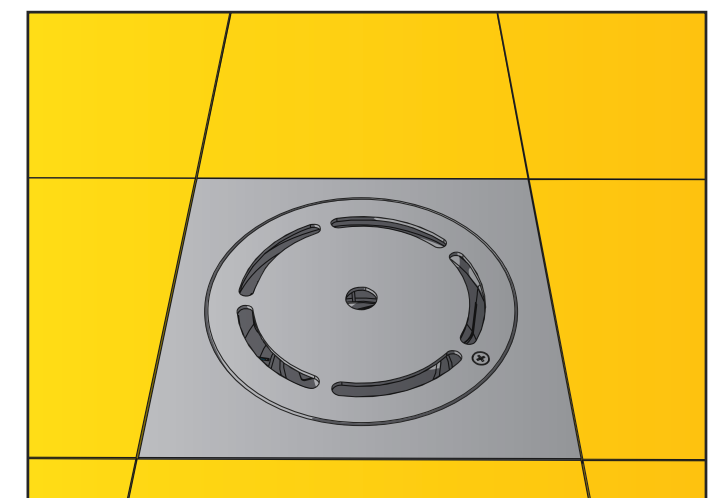

Your Herbish® floor drain is now maintained and should be checked weekly if possible or when the floor drain is not draining as it should be.